

Promat

PROMATECT® 250 **Board for protection of Structural Steel**



Structural Protection

etex inspiring ways
of living

PROMATECT® 250 PROMAXON® MINERAL BOARD

1.1	Autoclaved matrix engineered mineral board	3
1.2-3	How PROMAXON® technology works Improved PROMATECT® 250	3
1.4	Product properties	4
1.5	Loading/uploading, storage and handling of boards	5
1.6	Cutting	6
1.7	Fixing and fabrication	8
1.8	Finishing	10

GENERAL INFORMATION OF STRUCTURAL STEEL FIRE PROTECTION

2.1	Section factor (Hp/A)	11
2.2	Calculation of section factor (Hp/A) for various box protection	13
2.3	Guide of section factor (Hp/A) for encasement	14

PROMATECT® 250 STRUCTURAL STEEL FIRE PROTECTION

3.1	Hp/A ratio tables	16
3.2	PROMATECT® 250 structural steel column cladding	17
3.3	PROMATECT® 250 structural steel beam cladding	18
3.4	Architectural specifications	20

	SAFETY DATA SHEET (SDS)	22
--	--------------------------------	-----------

1.1 Autoclaved matrix engineered mineral board

Promat manufactures a number of autoclaved matrix engineered mineral boards, including PROMATECT®-L500, PROMATECT® 100 and PROMATECT® 250. The autoclave process exposes the mixture of raw materials to elevated temperatures and pressures to create the board products with versatile and beneficial properties, such as:

- Non combustibility
- Good impact and abrasion resistance
- Moisture tolerance
- Good dimensional stability
- Stability in fire conditions
- Good insulation properties when exposed to fire

The fire insulation properties of Promat's matrix engineered mineral boards are mainly due to the presence of a controlled moisture content held within the board.

PROMATECT®-L500 is a monolithic matrix engineered mineral board formed by pressing together autoclaved spheres (known as PROMAXON® technology).

1.2 How PROMAXON® technology works

PROMAXON® is a synthetic hydrated matrix engineered mineral in spherical form. The outer shell of close-knit micropores forms the linking network for the mineral matrix of both PROMATECT® 100 and PROMATECT® 250 products. This is a key factor in the board's cohesion and stability in fire conditions. A mineral additive acts as filler in the gaps between the spherical PROMAXON® particles.

In fire, the release of free water within the board, and then the chemically bound water from the mineral matrix, cause a cooling effect which reduces the temperature rise on the non fire side of the board. However, before the water can escape from the board, the PROMAXON® spheres recapture part of the water that has been released. This then creates a further endothermic process that gradually releases the recaptured water molecules, thus creating a further drop in the rate of temperature rise.

As a result, PROMATECT® 250 is a creation of new generation Promat boards that combine the advantages of traditionally manufactured matrix engineered mineral and gypsum boards AND outstanding advantages of the PROMAXON® technology.

1.3 Improved PROMATECT® 250

PROMATECT® 250 is a hybrid development of matrix engineered mineral and gypsum board using PROMAXON® technology. The composition of the new PROMATECT® 250 board contains a key component which improves the fire insulation of the product – thanks to an endothermic process which produces a chemical change accompanied by the absorption of heat!

The critically important component is autoclaved matrix engineered mineral spheres bound in a mineral matrix. It is PROMAXON® technology in combination with the mineral matrix that eventually creates the endothermic process when exposed to fire. The end result is significantly better fire insulation than that provided by either traditional matrix engineered mineral boards or gypsum boards.

The new PROMATECT® 250 boards have both a small amount of free water in the PROMAXON® spheres and chemically bound water in the mineral matrix. By producing more water and retaining it longer within the board, fire insulation is therefore improved.

Benefits of the PROMAXON® technology boards:


- Superior insulation properties when exposed to fire
- Improved strength and fire insulation
- Improved surface finish
- Impact resistant
- Better workability, easier to scribe and install
- Proven cost effective lightweight drywall systems

1.4 Product properties

PROMATECT® 250 comprises autoclaved calcium silicate spheres bound in a mineral matrix. This PROMAXON® technology – a synthetic hydrated calcium silicate in spherical form – provides excellent performance in most fire resistant applications.

PROMATECT® 250 is off-white in colour. The front face is smooth and is suitable for any forms of architectural/finishing treatment; the reverse face is sanded.

PROMATECT® 250 is resistant to moist conditions and will not physically deteriorate in humid environment. Whilst its performance characteristics are not degraded by moisture or aging, PROMATECT® 250 is not designed for application in areas subject to continual damp or high temperatures. The product is recommended for interior applications only.

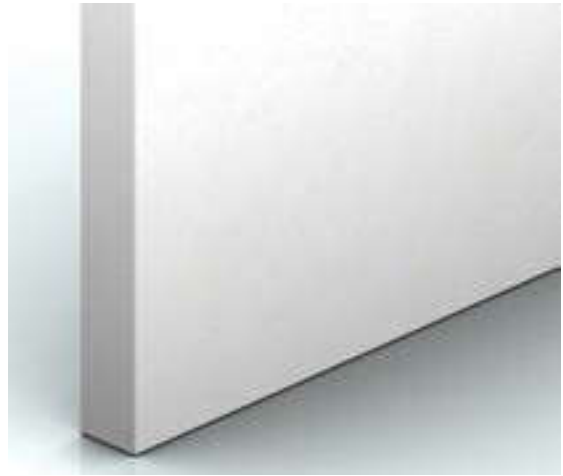

Material properties

Generic description	PROMAXON® mineral board
Surface condition	Front face: smooth Back face: sanded
Building regulations	Class 0
Alkalinity	pH 9
Coefficient of expansion	-14 x 10 ⁻⁶ m/mk
Thickness tolerance	±0.5mm (standard thickness boards)
Dimension tolerance	±0-3mm (standard dimension boards)

Physical performance

Property	Test method	Test results
Density	BS EN 323	Nominal 750kg/m ³
Flexural strength, F_{rupture}	BS EN 310	Longitudinal 3N/mm ²
Tensile strength, T_{rupture}	BS 5669: Part 1	Longitudinal 0.97N/mm ² Transverse 1.18N/mm ²
Compressive strength	BS 5669: Part 1	5.39N/mm ²
Combustibility	BS 476: Part 4 AS 1530: Part 1 DIN 4102: Part 1	Non combustible
Thermal conductivity	ASTM C518	0.183W/m ² K
Moisture content	BS EN 322	2%

Health and safety

When machining the PROMATECT® 250 product, airborne dust may be released, which may be hazardous to health. Do not inhale the dust. Avoid contact with skin and eyes. Use dust extraction equipment. Respect regulatory occupational exposure limits for total inhalable and respirable dust. A health and safety data sheet is available from Promat and, as with any other material, should be read before working with the product.

PROMATECT® 250 product is not classified as a dangerous substance so no special provisions are required regarding the transportation and the disposal of the product to landfill. The product can be placed in on-site rubbish skips with other general building waste which should then be disposed by a registered contractor in the appropriate and approved manner.

Standard thickness	Standard dimension	Number of boards per pallet	Surface per pallet	Weight of boards per m ²	Weight per pallet
15mm	2500mm x 1200mm	48	144m ²	Approx. 11.25kg	Approx. 1620kg
20mm	2500mm x 1200mm	35	105m ²	Approx. 15.0kg	Approx. 1575kg
25mm	2500mm x 1200mm	28	84m ²	Approx. 18.75kg	Approx. 1575kg
30mm	2500mm x 1200mm	24	72m ²	Approx. 22.5kg	Approx. 1620kg

All properties herein are mean values given for information and guidance only. If certain properties are critical for a particular application, it is advisable to consult Promat. PROMATECT® 250 is manufactured under a quality management system certified in accordance with ISO 9001: 2008. The product has passed the site audit in accordance with the environmental standards of ISO 14001: 2004 and occupational health and safety requirements of OHSAS 18001: 2007.

1.5 Loading/uploading, storage and handling of boards

1.5.1 Loading/uploading

PROMATECT® 250 boards are supplied on pallets suitable for fork lift unloading. If off-loading by crane and slings is envisaged, care should be taken to avoid damaging edges of the boards. All pallets and crates can be safely handled by using a fork lift or hoisting equipment and straps. Steel cables or chains should not be used as they will damage both the pallet and the boards. Where crates are removed from a box container, care should be taken not to subject crates and pallets to any impact shock, as this could result in cracking of the boards.

Always drive the delivery vehicle as close as possible to where the boards are to be used. When transporting the boards, it is essential to secure the pallets to prevent sliding. If the boards are subsequently moved around the site, they should be placed on a rigid base suitable for lifting by forklift. Promat boards should always be stored on a rigid base.

1.5.2 Storage

PROMATECT® 250 boards are supplied with protective plastic sheet wrapped around the timber crates. This protection should not be removed until the boards are ready for use.

In general, the following steps should be taken to ensure that the boards remain in good condition during storage.

- a) The boards should be stored and stacked on covered and dry, level ground, away from the working area or mechanical plant.
- b) Pallets should be a maximum of 800mm height ($h \leq 800\text{mm}$) on firm level ground. If two or more pallets are stacked, the total stack height must be less than 3200mm ($H \leq 3200\text{mm}$).



- c) The stacked boards must be stored under cover completely for protection from inclement weather.



1.5.3 Handling

Following recommendation must be always taken into account when handling PROMATECT® 250 boards:

- a) Wherever possible, always lift the boards from underside rather than slide the boards on each other on the stack to prevent damage or scratches on surface of the boards.



- b) Always carry the boards on edge but do not store on the edge.



1.6 Cutting

Promat recommends that all cutting be carried out in well ventilated spaces, using dust extraction facilities. Operators should wear protective face masks at all times.

There are a wide variety of applications and fixing methods possible with PROMATECT® 250 boards. The method to be used is dependent on a number of factors, including:

- 1) The shape of the board's final application, be it square, rectangular or circular etc.
- 2) The location where the work is to be carried out, be it industrial, commercial, on or off site etc.
- 3) The quality of workmanship required.

PROMATECT® 250 boards can be cut on site fairly easily. However, if a large number of boards are to be cut, it is recommended that cutting is carried out off site under controlled conditions as much as possible to ensure good quality of finished edges etc.

A few general rules should be observed when working with the boards as follows:

- For industrial quality cutting and extended cutting life of tools, working with diamond tipped saws is recommended. Experience shows that tools with tungsten carbide blades provide a more than adequate cut.
- High speed electric tools generate very fine dust. Inhaling fine dust can be harmful to health, dust extraction equipment or wet cutting is thus necessary. Although Promat boards contain no harmful fibres, inhalation of excessive nuisance dust can be detrimental. It is also recommended that when cutting or drilling the boards, appropriate face masks and personal protection equipment (PPE) should always be worn.
- Slow running tools produce coarse dust or chips but are not as efficient at cutting.
- The speed of cutting is best determined by thickness of the board, hardness of the board and condition of the blade.
- Boards must be held securely during cutting to avoid slippage and vibration which can lead to chipping of the board edges.
- The choice of the most appropriate tool for use in each country will depend on custom, practice and local regulations.

1.6.1 Guillotine

The knife of the guillotine is parallel to the board support so that a consistent, even cut is made at the same moment over the entire length of the board. Up to a maximum thickness of 6mm, a reasonably neat, square cut can be achieved but the

edge remains rough. The machine cuts the sheets one by one and is not suitable for textured surfaces.

1.6.2 Tungsten carbide blades

Tungsten carbide tipped saws can be used with either a high or low speed electric motor. The cutting is done in a dry state so dust extraction is essential. The tungsten carbide teeth of the saw have a shorter life span than diamond tipped blades but they can be sharpened by a skilled professional.

1.6.3 Diamond tipped blades

Cutting with diamond tipped blades is carried out using high speed electric motor at 2500-3000rpm depending on diameter of blade. There are two types:

- 1) Machine with fixed table and moving saw support
- 2) Machine with fixed saw support and moving table

The saw support can be equipped with several parallel saws for multi cutting in a single pass of the blades over the boards. A diamond tipped blade can be used in either a wet or dry state.

The disadvantage of wet cutting is the generation of cement slurry which forms from the mixture of the dust and water. This must be drained off in an appropriate way. In addition, it is necessary to rinse the saw after each use to maintain the cutting quality. Wet cutting is not an ideal solution for Promat boards.

The boards should be cleaned after cutting to avoid leaving any dust on the surface.

Diamond blades can be used to cut more than one board at a time, depending on the diameter of the saw blade and the thickness of the boards.

1.6.4 Industrial machines

Industrial machines are used for continuous cutting over long periods of time, for large quantities and for better efficiency. Standard industrial machine is for dry cutting and is available in high and low speed electric motors.

High speed electric motor with diamond tipped blades can be used for other building materials such as concrete, natural stone, brick etc. Low speed motor with tungsten carbide tipped blades is more suitable for cutting fibre cement materials.

Cutting PROMATECT® 250 boards with low speed motor provides a neat cut and smooth edges.

1.6.5 On site machines

While working at site, hand tools and low speed electric tools are generally recommended. When high speed electric tools are used, dust extraction is essential.

Power tools with dust extraction equipment

Sawing machines such as FESTO, Bosch, Makita etc work with a tungsten carbide tipped saw blade on a low speed electric motor and move over a fixed working table. It is a typical machine for occasional use on site producing very good results and is capable of cutting boards with maximum thickness up to 30mm.

A vacuum cleaner is recommended for use while cutting especially when using power saws. As an additional safety precaution, always wear eye, ear and dust protection when using power tools of any type. A portable version of the working table is available for the convenience of board cutting on site.

While working with power saws, the following important points should be observed:

- Ensure that the boards to be cut are continuously and well supported on either side of the cut.
- A straight edge should be clamped in position to guide the cutting operation.
- Care must be taken to ensure the tool remains against the straight edge during the cutting operation.
- The cutting rate should be such that the blade is not labouring or over-heating. Feed speed for fibre cement boards is normally slower than for natural timber.

Jigsaw



This is applicable for panels up to 30mm thick. The panels can be cut easily with a jigsaw to form various shapes. Blades with special hardened teeth are available for cutting Promat boards. As with all power tools, care should be taken to cut within the capacity of the tool and blade. Do not force the cutting speed.

Scoring knife

This tool is equipped with a tungsten carbide tipped point. It is suitable for use with panels up to 6mm thick. Several passes using a straight edge to guide the knife are required on the board surface to create an increasingly deep scored groove. The final break is obtained by applying pressure on the unsupported part of the board. The cut is relatively neat but the edge should be finished with glass paper or a manual or electric plane.

Hand saw



Hand sawing is suitable for general cutting operations and for small cuts, notchings or small penetrations. However, this method of cutting can be rather time intensive. The fastest way is to allow the saw to work at its own speed, trying to force the tool to cut faster merely blunts the teeth.

Drilling



Drilling can be carried out either by hand drill or any conventional power drill with or without dust extraction. For best results, the boards should be firmly supported behind the location of the holes. Generally when working on Promat boards, the use of drills with point angles of 60° to 80° rather than the more usual 120° type, are preferable and more efficient.

Rasp/surform

A rasp or surform can be used for edge finishing where necessary in order to trim away rough edging. For optimum edge finishing, dress the edges with fine glass paper.

1.7 Fixing and fabrication

PROMATECT® 250 boards are easy to handle and work using conventional tools. However, basic standard safety precautions should be routine at all times during installation.

This section highlights some general guidance in fixing and fabrication of the boards for fire resistant applications. Following tools are recommended:



The type of fixings used when installing PROMATECT® 250 boards are important as they determine the support of joints and stability of a structure. In general, a fixing should meet these rules and requirements:

- 1) Corrosion resistant.
- 2) Stainless steel, zinc or other plated self-drilling screws are recommended for steel framing.
- 3) Stainless steel or galvanised nails are recommended for timber framing. Do not use screws when the board forms part of the structural bracing, unless tested with such fixings.
- 4) Fixing points should be located at least 12mm from the board edge and 50mm and 100mm from board corners. Nominal centres of fixing are generally recommended at 200mm throughout this handbook.

Fixings should be driven straight into the board and at best embedded no more than 0.5mm below the board surface. Do not damage the board around the fixing or at its edges. Cracked sheets should be replaced.

Use below fixing guide in conjunction with the illustration:

From edge	From corner	Centres at edge	Centres from midpoint
Minimum 12mm	50mm and 100mm	Depends on product and system. Please consult Promat.	

1.7.1 Screw fixing

When fixing PROMATECT® 250 boards, especially to steel frames, the following should be noted:

- Always predrill fixing holes unless using specially designed self-drilling screws suitable for fixing fibre cement to steel.
- Use a high torque, variable speed screw gun fitted with a depth gauge.
- Do not over drive, as this may reduce the holding capacity of the screw. Reduce drill speed as the screw pulls the board against the framing.

When fixing to steel framing, always fix to the open side of the flange first in order to maintain a flush outside face.


Pilot holes should be predrilled not less than 12mm from the edge of the boards and countersunk if required. Use self-drilling or self-tapping screws when securing boards to steel.

In most other situations, drywall screws (e.g. Hilo) are generally suitable. Board thicknesses greater than 15mm can be screwed board to board.

Self-drilling or self-tapping screws are suitable. If fixing board to board, minimum screw penetration should be 25mm or twice the board thickness, whichever is greater. If screws do not have a deep thread, pilot holes should be drilled and care should be taken not to over turn or over drive. Screws should be 50mm and 100mm from corners.

1.7.2 Staple fixing

PROMATECT® 250 boards may be stapled using an industrial staple gun. Staples may also be used for edge to edge fixing of boards 15mm or greater in thickness. Staples may be used when fire resistance is required, please consult Promat for further information.

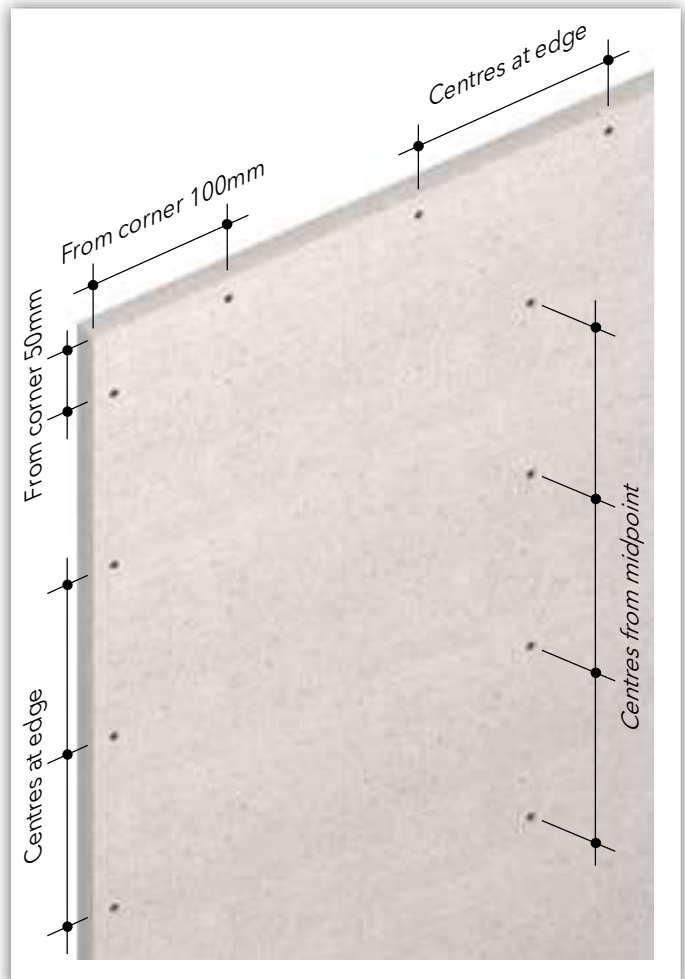

1.7.3 Forming holes

Apertures often need to be cut within a board to allow for penetration of services such as switchboxes, lights, access panels etc. The following procedures therefore serve as general guidelines only. Any method that allows for cutting of holes without damaging the board is acceptable.

1) For smooth, clean cut circular holes:

- Mark the centre of the hole on the board.
- Pre-drill a hole to be used as a guide.
- Cut the hole to the require diameter using a hole saw fitted to a heavy duty electric drill where the central bit is inserted into the predrilled hole or use a jigsaw.

2) For small irregular holes:


- Small rectangular apertures can be achieved by forming a series of small holes (using a drill) around the perimeter of the opening.
- Carefully tap out the waste piece from the panel face. Make sure that the edges are properly supported in order to avoid damage to boards.
- Rough edges can be cleaned with a rasp or 40 grit glass paper.

Below example of nailing and hammering for openings.




3) For large openings or apertures:

- Score deeply around the perimeter of the opening using a sharp tool (for thin boards only).
- Form a large round hole in the centre using the method previously described.
- Saw cut from the centre towards the corners of the opening.
- Tap waste pieces from the face side and if necessary clean rough edges with a rasp or with at least 40 grit sand paper. Radius corners with a half round rasp to eliminate any stress points.

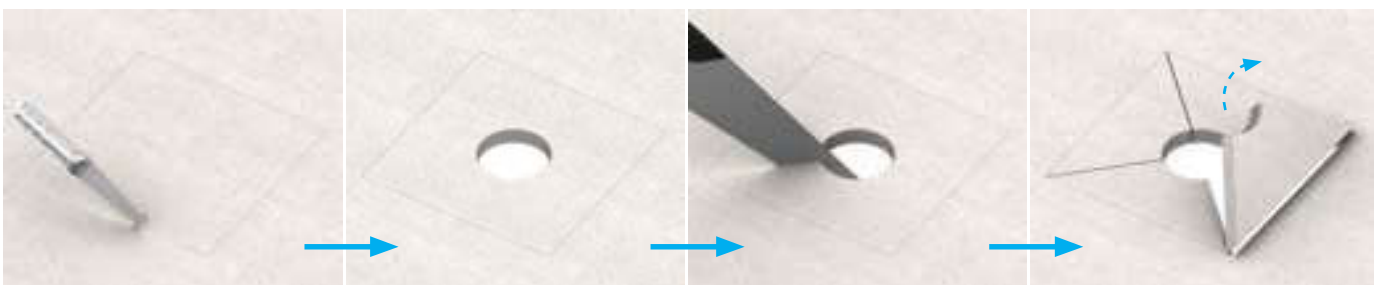

Alternatively, for neater openings:

- Pre-drill a hole of at least 10mm diameter at the four corners of the openings. Mark lines from hole to hole (forming a rectangular shape) as a guide and cut along the lines using a jigsaw or hand saw.
- Clean rough edges of the hole with a rasp.

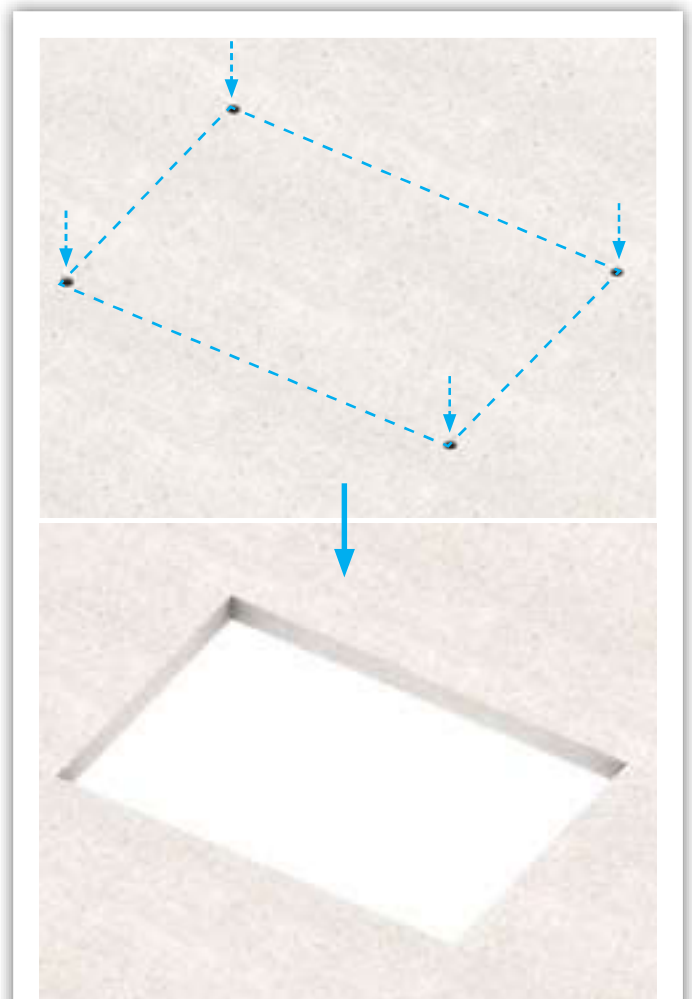

Apertures opening using alternative method: Never make holes by using heavy hammers, cold chisels or other "aggressive" methods. This will damage the underside of the boards and adversely effect the fire performance of the system.

1.8 Finishing

1.8.1 Plastering / skim coating

The preferred and best quality finishing method for PROMATECT® 250 protected steel members is to use a skim coat across the whole face of the board. External angles should be placed on each corner then a standard off the shelf skim coat system suitable for plasterboard be applied in accordance with the manufacturer's recommendations.

PROMATECT® 250 boards have a high suction factor and while successful skim coats are relatively easy to obtain, some care is needed to retard the rapid drying of plaster coats, especially in areas of high temperature.

It is recommended that a small test area is plastered initially to ensure that the boards have been adequately sealed. Use of self-adhesive or hessian scrim applied over joints and internal angles is considerable. Paper scrim is not recommended. The bonding agent and plaster manufacturer's recommendations must be followed at all times.



Plastering the board joints in structural steelwork and the partitions (on background of the picture).

1.8.2 Tiling

PROMATECT® 250 boards can be tiled, provided due consideration is given to the installation of the boards and the requirements for additional framing prior to applying the tiles.

It should be noted that PROMATECT® 250 board application systems are used for their fire resistance performance. Therefore placing additional weight on an application system, such as ceramic or marble tiling for instance, can have significant effect on the overall fire resistance performance of the system.

As such, additional framing is required for partition systems etc which bear the weight of tiles in order to maintain the fire resistance performance.

As a general rule of thumb, partition systems to be tiled should be constructed with framing at nominal 450mm centres in both vertical and horizontal orientations. Minimum board thickness is applicable.



Applying tile adhesive on PROMATECT® 250 boards prior to tiling.

Care must be taken in sealing the boards thoroughly before applying any tile adhesive as the boards' high suction load will accelerate the setting time of the tile adhesive.

1.8.3 Painting

All coatings should be supplied by a reputable manufacturer and their recommendations regarding surface preparation, sealing and finish coating should be followed at all times.

When using water based paints, a diluted first coat is recommended. For oil based paints a suitable alkali resisting primer should be used. Painted vapour barriers may be formed by the application of chlorinated rubber, epoxy resin or polyurethane paint.



The original smooth surface of PROMATECT® 250 boards can be painted with emulsion or oil based paints after applying with a universal primer. With water based paints, a diluted first coat should be applied. An alkali resisting primer is not required.

Depending on the type of finish required and the viewing circumstances (e.g. under glancing light), some minor surface imperfections of the painting result may occur.

Numerous research programmes show that some types of fully stressed steel sections can achieve a 30 minute fire resistance without any additional protection materials being applied. However, these apply to a limited number of steel sections only, based on the allowable Section Factor H_p/A . Section Factor is a common term used in fire protection for steelwork and is discussed in detail below.

Typical building regulations usually require certain elements of structure to be fire resistant for more than 30 minutes and up to a specified minimum period of time. The thickness of any fire protection material depends on a number of factors, such as:

- Duration of fire resistance specified
- Type of protection used, e.g. board, paint, spray etc
- Perimeter of the part of steel section exposed to fire
- Shape and dimensions of the steel section

To determine how these various factors affect the fire resistance, most Promat products and systems have been tested at nationally accredited laboratories around the world to a variety of standards. Tests carried out in accordance with these standards are performed on both loaded and unloaded beams and columns which are clad with fire protection material. Steel surface temperatures are monitored with thermocouples to assess the performance of the cladding. Steel that is fully stressed in accordance with the design guides BS 449 or BS 5950: Part 1, begin to lose their design margin of safety at temperatures around 550°C.

The table below shows how the strength of steel reduces as temperatures rise, i.e. variation of effective yield strength factor of normal structural steels with temperature.

Temperature (°C)	20	100	200	300	400	500	600	700	800
Effective yield strength factor	1.00	1.00	1.00	1.00	1.00	0.78	0.47	0.23	0.11

For example, at 700°C, the effective yield strength of Grade 43 (S275) steel is $0.23 \times 275 = 63.25\text{N/mm}^2$.

A range of unloaded sections are also tested to obtain data for analytical calculation, to measure exactly how much protection is needed for the most common steel sections and for providing fire resistance for different time periods.

IMPORTANT: When using PROMATECT® 250 protection systems for structural steelwork, conservative limiting temperatures of 550°C and 620°C are referred to for columns and beams respectively and are in general use throughout this brochure. Apart from temperature data, the fire tests also need to demonstrate the ability of cladding to remain in place, usually described as the “stickability” of the material, for the maximum duration for which the protection may be required. The availability of thin materials and the low weight of Promat systems, plus the possibility of prefabrication, ensure maximum cost efficiency.

2.1 Section factor (H_p/A)

The degree of fire protection provided depends on the H_p/A Section Factor for the steel section. The H_p/A factor is a function of the area of the steel exposed to the fire and the

mass of the steel section. The higher the H_p/A , the faster the steel section heats up and so the greater the thickness of fire protection material required.

It should be noted that in European design standards, the section factor is presented as A/V which has the same numerical value as H_p/A . A/V measures the rate of temperature increase of a steel cross section by the ratio of the heated surface area to the volume. It is likely to gradually replace the use of H_p/A .

Depending on type of material used for protection, the calculation method for H_p/A value may differ. Generally there are two methods of construction for the protection materials: box protection and profile protection.

2.1.1 Box protection using board materials

For box protection, H_p is the sum of the inside dimensions of the smallest possible rectangular or square encasement of the steel section. One exception is circular hollow sections.

Where a steel section abuts or is built into a fire resisting wall or floor, the surface in contact with or the surface within the wall or floor is ignored when calculating H_p . See [page 13](#). However, the value A is always the total cross sectional area of the whole steel section.

2.1.2 Castellated sections / cellform beams

These steel members heat up more quickly than the original section from which they were produced. Common practice is that protection thickness should therefore be 20% greater than those calculated from the H_p/A value of the original section from which the castellated section is formed.

However, it should be noted that the above information is now superseded by a new, more scientific approach for the protection of castellated sections. The following is taken from “Fire Protection for Structural Steel in Buildings”, 4th Edition, published by the ASFP (see www.asfp.org.uk).

The recently amended method of obtaining the section factor (H_p/A) for castellated sections is now specific. In fact, the recommendation from the Steel Construction Institute, published as RT 1085, for castellated sections and cellular beams manufactured from all rolled steel sections and from welded plate, the Section Factor for passive protection system is calculated as:

$$\text{Section factor (m}^{-1}\text{)} = 1400/t$$

Where t = the thickness (mm) of the lower steel web and applies for beams made from all steel rolled sections and from welded steel plate.

It should be noted that there are a number of conditions attached to the use of this calculation method, which are detailed in the ASFP “Yellow Book” publication.

Individual protection products, normally quite similar in performance when compared on the basis of rolled steel sections, may require radically different thicknesses for the same cellular beam.

2.1.3 Structural hollow section

The same thickness of board materials can be used on square, rectangular and circular hollow sections as on 'I' sections of the same H_p/A value.

2.1.4 Bracing

Bracing is included in a structure to give resistance to wind forces and provide overall stiffness. Masonry walls and steel cladding contribute to a structure's rigidity but these are rarely taken into account in design. Also, the probability of a major fire occurrence concurrent with maximum wind load is remote (see BS 5950: Part 8). It seems unreasonable therefore to apply the 550°C steel temperature criteria to bracing. While each case must be judged on individual merits, protection to bracing is generally not necessary, but where it is required the H_p/A value of the bracing section or 200m^{-1} should be used, whichever is the lesser.

2.1.5 Lattice members

As the determination of the protection necessary to protect lattice members requires broad consideration of the lattice design, please consult Promat concerning such steel sections.

2.1.6 Partially exposed members

Where columns or beams are partly built into or are in close contact with walls or floors, the protection afforded to the steelwork by the wall or floor should be taken into account. In those instances where the steel section sits within or against masonry or concrete constructions, this will give protection to the adjacent surface of the steelwork. Thus, for the purpose of determining the heated perimeter (H_p), this should be taken as only that part of the steel section which is exposed. It should be noted that where the steelwork penetrates both sides of a fire resisting construction, e.g. a wall protruding into a space which has an open end, simultaneous attack from fire on both sides may occur on columns partially exposed within the wall. In such an instance, the section factor should be calculated based upon the sum of the areas exposed to fire on either side of the wall and the total volume of the steel section.

Note that separating elements are generally required to offer a performance including the insulation criteria of 140°C or 180°C. Therefore, where a steel section passes through a separating element and is exposed on both sides, consideration must also be given to providing sufficient protection not only to maintain the temperature of the steel section below 550°C but also to ensure the surface temperature on the unexposed face does not exceed the 140°C or 180°C insulation criteria of the separating element. Due allowance for any expected building movement should also be considered.

2.1.7 External lightweight walls

Where the structural elements form portal legs supporting a lightweight external wall, the insulation performance required of the wall may contribute to the protection of any column

flange falling within the thickness of the wall. In such cases, please consult Promat to confirm the board thickness and which areas of such columns should be protected.

2.1.8 Internal lightweight partitions/walls

Where a column or beam is built into a fire resistant lightweight wall or partition, the protection to the steelwork can generally be designed on the assumption that only one side of the wall or partition will be exposed to fire at any one time. The wall or partition should be adequately secured to the column in such a way as to ensure the wall or partition will not apply stress on the protection encasement. Due allowance for any expected building movement should be considered.

2.1.9 Floors

Where beams are wholly within the cavity of a timber floor protected by a PROMATECT®-H ceiling, test evidence shows that the cavity air temperature of the floor is such that the beam will be adequately protected to the same fire resistance by the ceiling that protects the floor. Where the beam is wholly or partly below the line of the PROMATECT®-H ceiling then H_p should be based upon the portion of the steel beam that is below ceiling level.

2.1.10 Beams supporting composite floors with profiled metal decking

A series of fire resistance tests has demonstrated that it is not always necessary to fill the void formed between the top flange of a beam and the underside of a profiled steel deck. Recommendations based on the research have been published by the Steel Construction Institute (UK) and for decks running perpendicular to the beams, are as follows:

DOVETAIL DECKS

Voids may be left unfilled for all fire resistance period, unless a fire resisting wall or partition is located beneath the beam.
























TRAPEZOIDAL DECKS

Generally, voids may be left unfilled for up to 60 minutes fire resistance. Also, for 90 minutes if the board thickness used is appropriate for the $H_p/A + 15\%$. Care should be taken to ensure that if the voids are unfilled, the main encasement will need to be adequately secured. For periods over 90 minutes the voids should be filled.

In all instances, voids should also be filled if a fire wall is located beneath the beam, for all fire resistance periods. These recommendations apply to board encasements. The trapezoidal steel deck slab should be designed to act structurally with the beam. If this is not the case, the voids should be filled for all fire resistance periods.

2.2 Calculation of section factor (H_p/A) for various box protection

Protection configurations with values of perimeter H_p for use in the calculation of section factor H_p/A (A/V)

Steel section	Box protection				
Universal beams, universal columns and joists (plain and castellated) 	Four sides  $2B + 2D$	Three sides  $B + 2D$	Three sides (partially exposed)  $B + 2d$	Two sides  $B + D$	One side (partially exposed)  B
Structural and rolled tees 	Four sides  $2B + 2D$	Three sides (flange to soffit)  $B + 2D$	Three sides (toe of web to soffit)  $B + 2D$		
Angles 	Four sides  $2B + 2D$	Three sides (flange to soffit)  $B + 2D$	Three sides (toe of flange soffit)  $B + 2D$		
Channels 	Four sides  $2B + 2D$	Three sides (web to soffit)  $2B + D$	Three sides (flange to soffit)  $B + 2D$		
Square or rectangular hollow sections 	Four sides  $2B + 2D$	Three sides  $B + 2D$			
Circular hollow sections 	Four sides  πD	NOTE: The air space created in boxing a circular section improves the insulation and the value of H_p/A . Therefore, H_p higher than profile protection (p) would be anomalous. Hence, H_p is taken as the circumference of the circular section and not $4D$.			

Following is an example of calculation for a universal beam section using box protection of 305mm x 305mm x 240kg/m serial size to be encased on three or four sides when $A = 305.6\text{cm}^2$, $B = 317.9\text{mm}$, $D = 352.6\text{mm}$, $t = 23\text{mm}$.

Four sided profile protection:

$$\begin{aligned}
 H_p &= 2B + 2D \\
 &= (2 \times 317.9) + (2 \times 352.6) \\
 &= 1341\text{mm} (1.341\text{m}) \\
 H_p/A &= 1.341 \div 0.03056 \\
 &= 43.9\text{m}^{-1}
 \end{aligned}$$


Three sided profile protection:

$$\begin{aligned}
 H_p &= B + 2D \\
 &= 317.9 + (2 \times 352.6) \\
 &= 1023.1\text{mm} (1.023\text{m}) \\
 H_p/A &= 1.023 \div 0.03056 \\
 &= 33.5\text{m}^{-1}
 \end{aligned}$$

The above calculated values are approximate in that radii at corners and roots of all sections are ignored. In these figures, $H_p/A = A/V$.


2.3 Guide of section factor (H_p/A) for encasement

2.3.1 Universal column cladding up to 180/-/- in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100 (4-sided universal columns)



Section	D	B	Weight	H_p/A	Critical temperature 550°C			
					60/-/-	90/-/-	120/-/-	180/-/-
310UC158	372	311	158.0	68	15mm	15mm	15mm	25mm
310UC137	321	309	137.0	72	15mm	15mm	15mm	30mm
310UC118	315	307	118.0	83	15mm	15mm	20mm	30mm
310UC97	308	305	96.8	99	15mm	15mm	20mm	20+15mm
250UC89	260	256	89.0	91	15mm	15mm	20mm	20+15mm
250UC73	254	254	73.0	109	15mm	15mm	25mm	20+15mm
200UC60	210	205	60.0	109	15mm	15mm	25mm	20+15mm
200UC52	206	204	52.2	123	15mm	15mm	25mm	20+20mm
200UC46	203	203	46.2	138	15mm	15mm	25mm	20+20mm
152UC37	162	154	37.2	133	15mm	15mm	25mm	20+20mm
152UC30	158	153	30.0	162	15mm	15mm	30mm	20+25mm
152UC23	152	152	23.4	205	15mm	15mm	30mm	20+25mm
100UC15	97	99	14.8	208	15mm	15mm	30mm	20+25mm


2.3.2 Hollow section column cladding up to 180/-/- in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100 (4-sided hollow section columns)



Section	D	B	Weight	H_p/A	Critical temperature 550°C			
					60/-/-	90/-/-	120/-/-	180/-/-
250 x 250 x 9	250	250	65.9	119	15mm	15mm	25mm	20+20mm
250 x 250 x 6	250	250	45.0	174	15mm	20mm	30mm	20+25mm
200 x 200 x 9	200	200	51.8	121	15mm	15mm	25mm	20+20mm
200x 200 x 6	200	200	35.6	176	15mm	20mm	30mm	20+25mm
200 x 200 x 5	200	200	29.9	210	15mm	25mm	30mm	20+25mm
150 x 150 x 9	150	150	37.7	125	15mm	15mm	25mm	20+20mm
150 x 150 x 6	150	150	26.2	180	15mm	20mm	30mm	20+25mm
150 x 150 x 5	150	150	22.1	213	15mm	25mm	30mm	-
125 x 125 x 9	125	125	30.6	128	15mm	20mm	25mm	20+20mm
125 x 125 x 6	125	125	21.4	183	15mm	20mm	30mm	20+25mm
125 x 125 x 5	125	125	18.2	216	15mm	25mm	30mm	-
100 x 100 x 9	100	100	23.5	134	15mm	20mm	25mm	20+20mm
100 x 100 x 6	100	100	16.7	188	15mm	25mm	30mm	20+25mm
100 x 100 x 5	100	100	14.2	221	15mm	25mm	30mm	-
89 x 89 x 6	89	89	14.7	190	15mm	25mm	30mm	20+25mm
89 x 89 x 5	89	89	12.5	224	15mm	25mm	30mm	-
75 x 75 x 6	75	75	12.0	196	15mm	25mm	30mm	20+25mm
75 x75 x 5	75	75	10.3	229	15mm	25mm	15+20mm	-
65 x 65 x 6	65	65	10.1	202	15mm	25mm	30mm	20+25mm
65 x 65 x 5	65	65	8.75	233	15mm	25mm	15+20mm	-

2.3 Guide of section factor (H_p/A) for encasement

2.3.3 Universal beam cladding up to 180/-/- in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100 (3-sided universal beams)



Section	D	B	Weight	H_p/A	Critical temperature 620°C			
					60/-/-	90/-/-	120/-/-	180/-/-
610UB125	612	229	125.0	91	15mm	15mm	15mm	30mm
610UB113	607	228	113.0	100	15mm	15mm	15mm	25mm
610UB101	602	228	101.0	111	15mm	15mm	20mm	30mm
530UB92	533	209	92.4	108	15mm	15mm	20mm	30mm
530UB82	528	209	82.0	121	15mm	15mm	20mm	15+20mm
460UB82	460	191	82.1	106	15mm	15mm	20mm	30mm
460UB74	457	190	74.6	116	15mm	15mm	20mm	15+20mm
460UB67	454	190	67.1	128	15mm	15mm	20mm	15+20mm
410UB60	406	178	59.7	130	15mm	15mm	20mm	15+20mm
410UB54	403	178	53.7	144	15mm	15mm	25mm	15+20mm
360UB57	359	172	57.0	122	15mm	15mm	20mm	15+20mm
360UB51	356	171	50.7	137	15mm	15mm	20mm	15+20mm
360UB45	352	171	44.7	154	15mm	15mm	25mm	15+20mm
310UB46	307	166	46.2	133	15mm	15mm	20mm	15+20mm
310UB40	304	165	40.4	150	15mm	15mm	25mm	20+20mm
310UB32	298	149	32.0	183	15mm	20mm	25mm	20+20mm
250UB37	256	146	37.3	139	15mm	15mm	20mm	15+20mm
250UB31	252	146	31.4	162	15mm	15mm	25mm	20+20mm
250UB25	248	124	25.7	189	15mm	20mm	25mm	20+20mm
200UB30	207	134	29.8	144	15mm	15mm	25mm	15+20mm
200UB25	203	133	25.4	167	15mm	15mm	25mm	20+20mm
200UB22	202	133	22.3	189	15mm	20mm	25mm	20+20mm
200UB18	198	99	18.2	214	15mm	20mm	30mm	20+25mm
180UB22	179	90	22.2	158	15mm	15mm	25mm	20+20mm
180UB18	175	90	18.1	191	15mm	20mm	25mm	20+20mm
180UB16	173	90	16.1	213	15mm	20mm	30mm	20+25mm
150UB18	155	75	18.0	168	15mm	15mm	25mm	20+20mm
150UB14	150	75	14.0	210	15mm	20mm	30mm	20+25mm

Above table provides information relating to the 3-sided encasement of steel beams where a concrete deck is directly supported onto the top flange of the beam, where the concrete acts as a heat sink and where the beams are generally not fully loaded, therefore a temperature of 620°C is considered appropriate.




Where the beam supports a floor of a different construction other than plain concrete, this failure temperature may not be applicable. If in doubt, please consult Promat or your local structural engineer.

Hp/A ratio table 1 Up to 180/-/- fire resistance in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100 (reports no. FC15555) for structural steel column protection at critical temperature of 550°C

Fire resistance	PROMATECT® 250 board thickness (mm)														
	15	18	20	22	25	27	30	31	32	33	34	35	36	40	45
60 minutes	260	300	300	300	300	300	300	300	300	300	300	300	300	300	300
90 minutes	125	155	185	223	300	300	300	300	300	300	300	300	300	300	300
120 minutes	80	95	105	120	150	175	225	250	280	300	300	300	300	300	300
180 minutes	-	55	55	60	70	75	90	95	100	105	110	115	120	150	210

Hp/A ratio table 2 Up to 180/-/- fire resistance in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100 (reports no. FC15555) for structural steel beam protection at critical temperature of 620°C

Fire resistance	PROMATECT® 250 board thickness (mm)														
	15	18	20	22	25	27	30	31	32	33	34	35	36	40	45
60 minutes	300	300	300	300	300	300	300	300	300	300	300	300	300	300	300
90 minutes	170	230	295	300	300	300	300	300	300	300	300	300	300	300	300
120 minutes	100	120	140	165	210	250	300	300	300	300	300	300	300	300	300
180 minutes	55	60	65	75	85	95	110	115	120	130	135	145	150	195	245

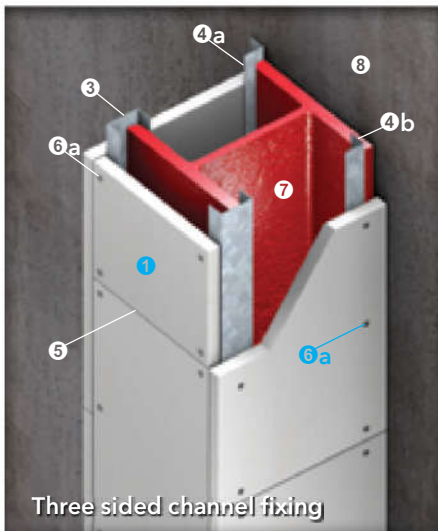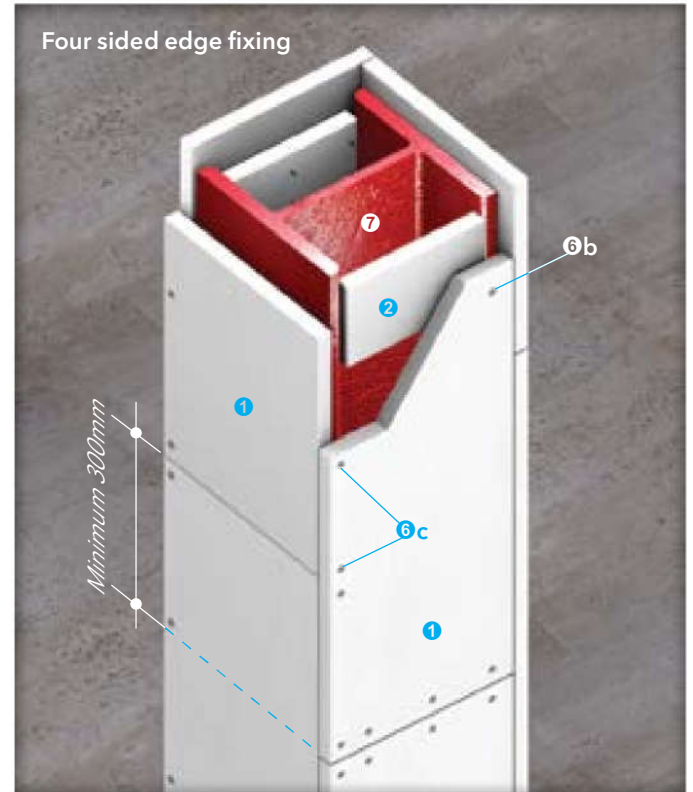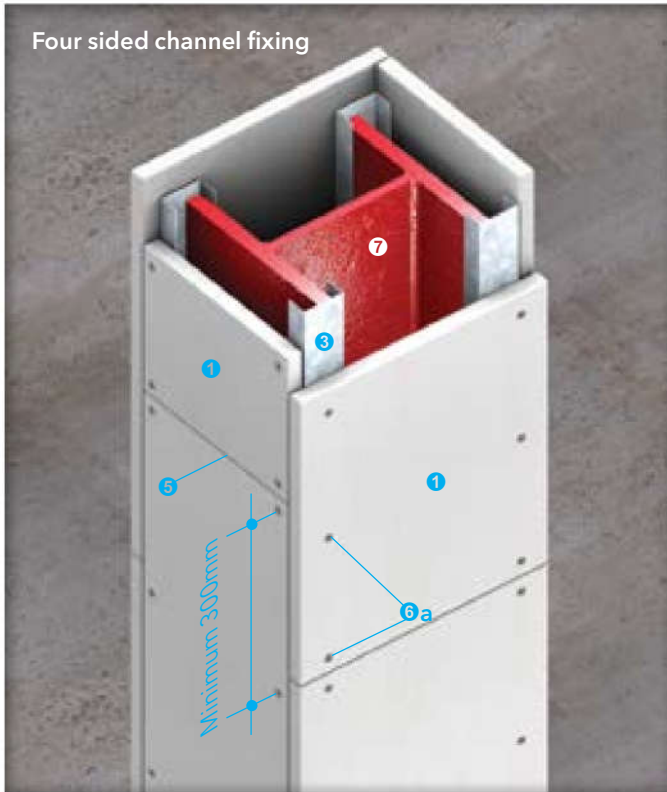


Up to 180/- fire resistance in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100

- ① PROMATECT® 250 board, thickness in accordance with the Hp/A ratio tables on page 16
- ② 100mm wide PROMATECT® 250 soldiers, minimum thickness similar to ①
- ③ Continuous galvanised steel channel 19mm x 38mm x 19mm x 0.8mm thick or equivalent, leg of each channel is located against inner surface of flange
- ④a Continuous galvanised steel angles minimum 32mm x 19mm x 0.8mm thick or equivalent fixed to the wall using non combustible proprietary anchors at nominal 500mm centres
- ④b Continuous galvanised steel angles minimum 32mm x 19mm x 0.8mm thick or similar fixed to the flange using Teks screws, shot fired nails or welding. Secure edges of side boards at 200mm centres
- ⑤ Horizontal joints in adjacent board sides to be staggered at minimum 300mm. For wide columns, it is advisable to include a PROMATECT® 250 cover strip behind the joints within the web of the steel column to provide additional impact resistance
- ⑥a Self-drilling or self-tapping drywall screws fixed to channel/angle at nominal 200mm centres. Screw length should be additional 20mm of the board thickness
- ⑥b Self-drilling or self-tapping drywall screws fixed to soldiers at nominal 100mm centres. Screw length should be additional 20mm of the board thickness
- ⑥c Steel wire staple fixings in accordance with table below. Screw fix is also suitable for edge fixing where 30mm thick boards are used


Board thickness	Steel wire staples at 100mm centres
15mm	44/10/1mm
20mm	44/10/1mm
25mm	50/10/1mm
30mm	60/10/1mm

⑦ Structural steel column

⑧ Concrete wall substrate

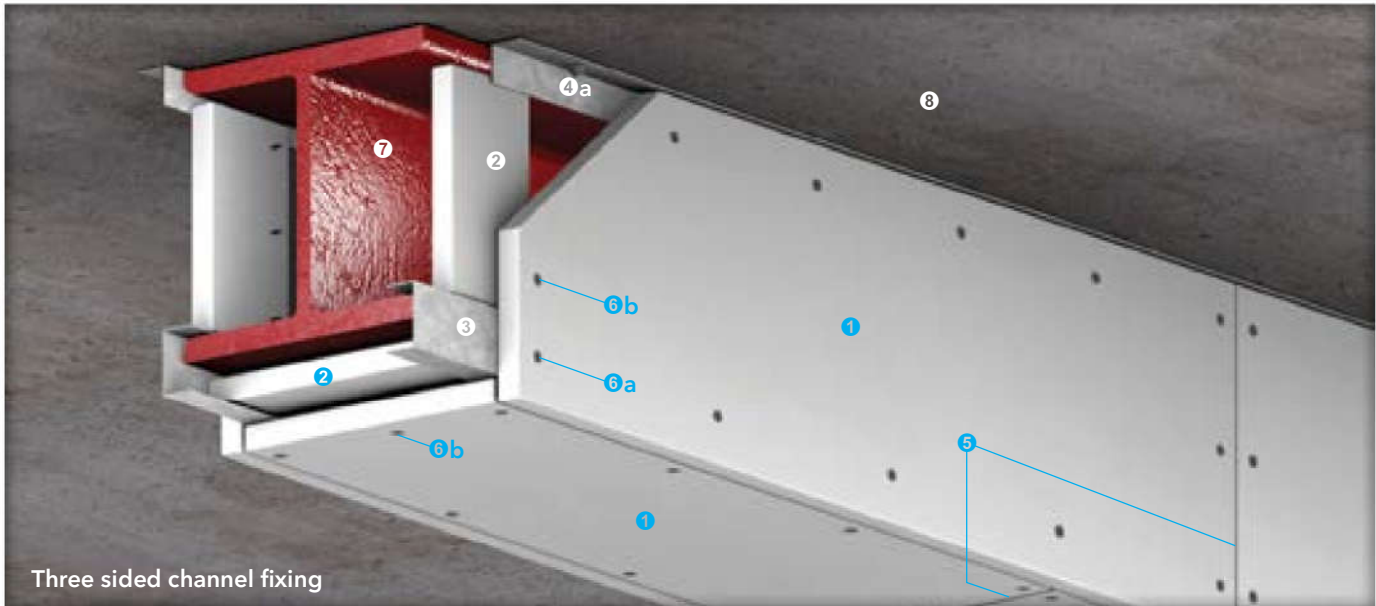


Three sided channel fixing

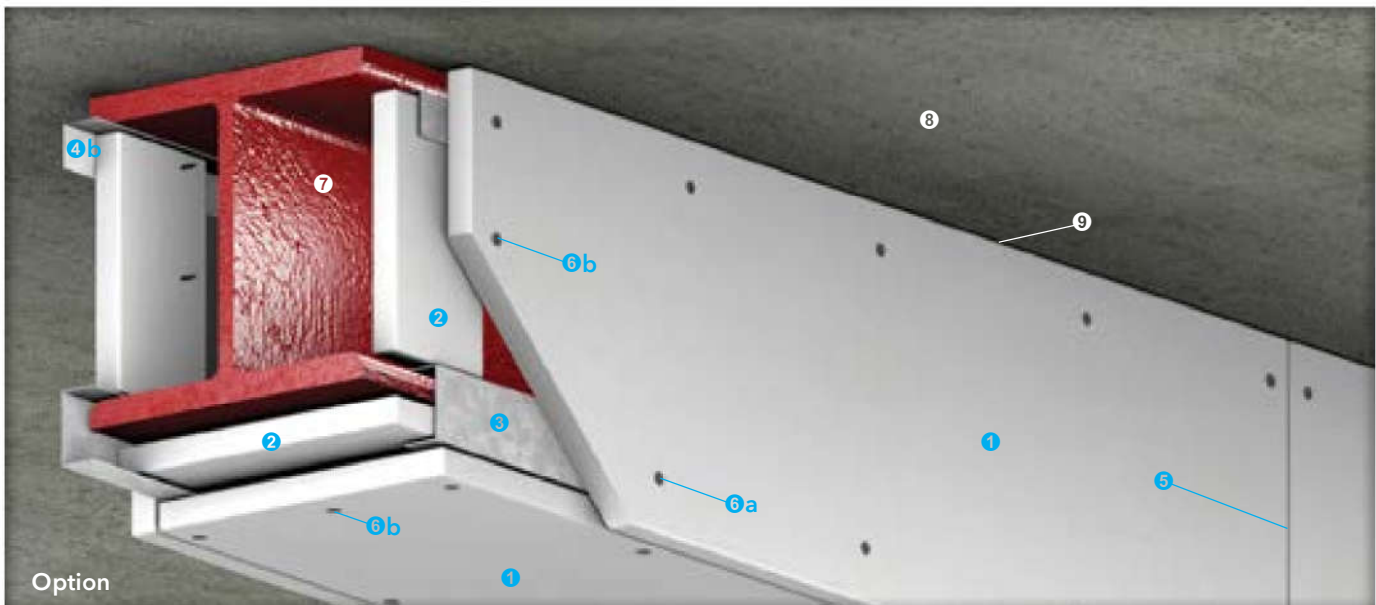

Option

Up to 180/- fire resistance in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100

- ① PROMATECT® 250 board, thickness in accordance with the Hp/A ratio tables on page 16
- ② 100mm wide PROMATECT® 250 soldiers, minimum thickness similar to the board thickness of ①, fixed within the web of the steel beam at maximum 1220mm centres behind the board joints using screws at 100mm centres or staples at 50mm centres
For deep beams clad with thicker boards for greater fire resistance, it is advisable to fix the soldiers at nominal 600mm centres in order to reduce the load on the soldiers. For steel beams greater than 600mm deep, a T-section soldier should be used to provide a stronger support
- ③ Continuous galvanized steel channel 19mm x 38mm x 19mm x 0.8mm thick or similar located at the bottom flange, leg of each channel is facing inner surface of the flange
- ④a Continuous galvanized steel angles minimum 32mm x 19mm x 0.8mm thick fixed to the floor slab using non combustible proprietary anchors at nominal 500mm centres
- ④a Continuous galvanized steel angles minimum 32mm x 19mm x 0.8mm thick or similar beneath the upper flange
- ⑤ Vertical and horizontal joints in adjacent board sides to be staggered at minimum 530mm
- ⑥a Self-drilling or self-tapping drywall screws fixed to channel/angle at nominal 200mm centres. Screw length should be additional 20mm of the board thickness
- ⑥b Self-drilling or self-tapping drywall screws fixed to soldiers at nominal 100mm centres. Screw length should be additional 20mm of the board thickness
- ⑦ Structural steel beam
- ⑧ Floor slab
- ⑨ Caulk all edges between the board and the floor slab with PROMASEAL®-A Acrylic Sealant, depth in accordance with the required board thickness

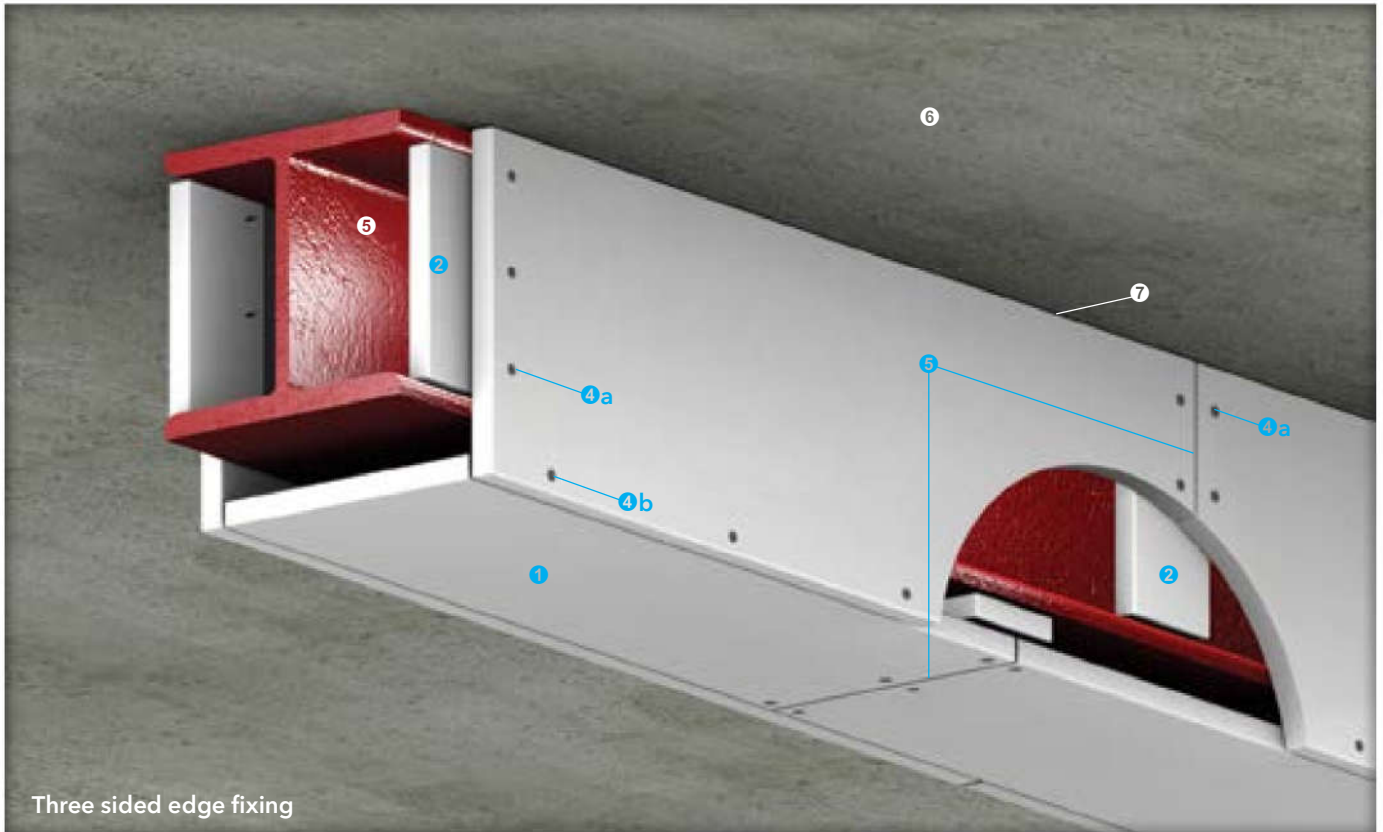

Three sided edge fixing

Up to 180/-/- fire resistance in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100

- ① PROMATECT® 250 board, thickness in accordance with the Hp/A ratio tables on page 16
- ② 100mm wide PROMATECT® 250 soldiers, minimum thickness similar to the board thickness of ①, fixed within the web of the steel beam at maximum 1220mm centres behind the board joints using screws at 100mm centres or staples at 50mm centres
For deep beams clad with thicker boards for greater fire resistance, it is advisable to fix the soldiers at nominal 600mm centres in order to reduce the load on the soldiers. For steel beams greater than 600mm deep, a T-section soldier should be used to provide a stronger support
- ③ Vertical and horizontal joints in adjacent board sides to be staggered at minimum 530mm
- ④a Self-drilling or self-tapping drywall screws fixed to soldiers at nominal 100mm centres. Screw length should be additional 20mm of the board thickness
- ④b Steel wire staple fixings in accordance with table below. Screw fix is also suitable for edge fixing where 30mm thick boards are used
- ⑥ Structural steel beam
- ⑦ Floor slab
- ⑧ Caulk all edges between the board and the floor slab with PROMASEAL®-A Acrylic Sealant, depth in accordance with the required board thickness

Board thickness	Steel wire staples at 100mm centres
15mm	44/10/1mm
20mm	44/10/1mm
25mm	50/10/1mm
30mm	60/10/1mm

Following are standard architectural specifications for structural steel column and beam protection using PROMATECT® 250. Please note that PROMATECT® 250 can be installed by using either screw or staple type of edge fixing. The end user must determine the suitability of any particular design to meet the performance requirements of any application before undertaking any work. If in doubt, please first obtain the advice from a suitably qualified engineer.

Where a column box encasement abuts a beam protected with a profiled fire protection system, e.g. intumescent paint, the column webs should be sealed at their tops using PROMATECT® 250. The installation methods described herein are suitable for steel sections up to 686mm deep and 325mm wide. For larger section or when protecting multiple sections within a single encasement, please consult Promat.

Fire exposure / area of application

Exposed faces of steelwork internal to building, for up to 120 minute fire resistance in accordance with the requirements of AS 1530: Part 4: 2014 & AS4100.

Location

(1)

Type of construction

_____ minutes⁽²⁾ fire resistance to PROMATECT® 250 one sided, two sided, three sided or four sided encasement of structural steel columns and beams.

Lining boards

One layer of _____mm x _____mm⁽³⁾ x _____mm⁽⁴⁾ thick PROMATECT® 250 PROMAXON® mineral boards as manufactured by Promat, cut to size on-site/pre cut in accordance with the schedule of sizes⁽⁵⁾ and fixed in accordance with the manufacturer's recommended details and fixing instructions.

Screw fixing

For columns, PROMATECT® 250 boards, minimum thickness 30mm to be fixed by board face to board edge using 50mm ^(6a) self-drilling, self-tapping screws at nominal 200mm centres.

For beams, vertical PROMATECT® 250 boards to be screwed to 100mm wide x _____mm⁽⁴⁾ thick PROMATECT® 250 soldiers wedged between flanges at 1200mm centres using _____mm^(6a) self-drilling, self-tapping screws at nominal 100mm centres. Where mechanical fixing is required for columns or beams, PROMATECT® 250 boards to be fixed by board face to board edge using _____mm^(6a) self-drilling, self-tapping screws at nominal 200mm centres to nominal 19mm x 38mm x 19mm x 0.8mm continuous pressed steel channels or similar at bottom steel flange AND to 32mm x 19mm x 0.8mm continuous pressed steel angles secured to soffit of floor/roof slab or top steel flange. The angles should be fixed at nominal 500mm centres.

Staple fixing

For columns, PROMATECT® 250 boards to be fixed by board face to board edge using _____mm^(6b) staples at nominal 100mm centres.

For beams, vertical PROMATECT® 250 boards to be screwed to 100mm wide x _____mm⁽⁴⁾ thick PROMATECT® 250 soldiers wedged between flanges at 1200mm centres using _____mm^(6b) staples at nominal 50mm centres. Where mechanical fixing is required for columns or beams, PROMATECT® 250 boards to be fixed by board face to board edge using _____mm^(6b) staples at nominal 100mm centres to nominal 19mm x 38mm x 19mm x 0.8mm continuous pressed steel channels or similar at bottom steel flange AND to 32mm x 19mm x 0.8mm continuous pressed steel angles secured to soffit of floor/roof slab or top steel flange. The angles should be fixed at nominal 500mm centres.

Board jointing for screw fixing

For beam casings only, PROMATECT® 250 board joints in the soffit to be backed with 100mm wide x minimum _____mm⁽⁴⁾ thick PROMATECT® 250 internal cover strips secured with _____mm⁽⁷⁾ self-drilling, self-tapping screws at nominal 100mm centres.

Board jointing for staple fixing

For beam casings only, PROMATECT® 250 board joints in the soffit to be backed with 100mm wide x minimum _____mm⁽⁴⁾ thick PROMATECT® 250 internal cover strips secured with _____mm⁽⁷⁾ staples to one side of board joint only.

Follow-on trades

Surface of boards to be prepared for painting/plastering/tiling⁽⁸⁾ in accordance with manufacturer's recommendations.

NOTES:

- (1) insert location or provide steelwork drawing reference.
- (2) insert required fire resistance level not exceeding 120 minutes.
- (3) insert required thickness by reference to section factor (H_p/A) and fire resistance level.
- (4) select board dimension on basis of economy in cutting. Standard board dimension is 2500mm x 1200mm.
- (5), (8) delete as appropriate.
- (6a) insert screw length which gives minimum 25mm penetration having regard to encasement thickness.
- (6b) insert staple length which gives minimum 25mm penetration having regard to encasement thickness.
- (7) insert screw length which is minimum 5mm longer than twice the encasement thickness.

4 Safety data sheet (SDS)

4.1 Product information

PRODUCT NAME	PROMATECT® 250
MARKETED BY	Promat Australia Pty Ltd
EMERGENCY CONTACT NUMBER	+61 (8) 8352 6759
USES	Fire resistant building and construction applications

4.2 Hazards identification

CLASSIFICATION OF THE SUBSTANCE OR MIXTURE	Not classified as hazardous according to Safe Work Australia Criteria.
LABEL ELEMENTS	No signal word, pictograms, hazard or precautionary statements have been allocated.
OTHER HAZARDS	No information provided.

4.3 Composition / Information on ingredients

INGREDIENT	CAS NO.	EC NO.	CONTENT
CALCIUM SILICATE	1344-95-2	215-710-8	>60%
QUARTZ (CRYSTALLINE SILICA)	14808-60-7	238-878-4	<1%
ADDITIVE(S)	–	–	Not available
BINDING AGENT	–	–	6-30%

4.4 First aid measures

EYE CONTACT	If in eyes, hold eyelids apart and flush continuously with running water. Continue flushing until advised to stop by a Poisons Information Centre (dial 13 11 26 Australia wide), a doctor or for at least 15 minutes.
INHALATION	If inhaled, remove from contaminated area. Apply artificial respiration if not breathing.
SKIN CONTACT	If skin or hair contact occurs, remove contaminated clothing and flush skin and hair with running water. Continue flushing with water until advised to stop by a Poisons Information Centre or a doctor.
INGESTION	For advice, contact a Poisons Information Centre or a doctor at once. Due to product form and application, ingestion is considered unlikely.
FIRST AID FACILITIES	None allocated.
MOST IMPORTANT SYMPTOMS & EFFECTS, BOTH ACUTE & DELAYED	See Section 4.11 for more detailed information on health effects and symptoms.
IMMEDIATE MEDICAL ATTENTION & SPECIAL TREATMENT NEEDED	Treat symptomatically.

This document has been compiled by Risk Management Technologies (RMT) on behalf of the manufacturer, importer or supplier of the product and serves as their safety data sheet (SDS). It is based on information concerning the product which has been provided to RMT by the manufacturer, importer or supplier or obtained from third party sources and is believed to represent the current state of knowledge as to the appropriate safety and handling precautions for the product at the time of issue. Further clarification regarding any aspect of the product should be obtained directly from the manufacturer, importer or supplier. While RMT has taken all due care to include accurate and up-to-date information in this SDS, it does not provide any warranty as to accuracy or completeness. As far as lawfully possible, RMT accepts no liability for any loss, injury or damage (including consequential loss) which may be suffered or incurred by any person as a consequence of their reliance on the information contained in this SDS.

Version no. 3.3, dated May 25th 2021.

4 Safety data sheet (SDS)

4.5 Fire fighting measures

EXTINGUISHING MEDIA	Non flammable. Use an extinguishing agent suitable for the surrounding fire.
SPECIAL HAZARDS ARISING FROM THE SUBSTANCE OR MIXTURE	Non flammable. May evolve toxic gases if strongly heated.
ADVICE FOR FIRE FIGHTERS	Non flammable. No fire or explosion hazard exists.
HAZCHEM CODE	None allocated.

4.6 Accidental release measures

PERSONAL PRECAUTIONS, PROTECTIVE EQUIPMENT & EMERGENCY PROCEDURES	Wear Personal Protective Equipment (PPE) as detailed in Section 4.5.8.
ENVIRONMENTAL PRECAUTIONS	Prevent product from entering drains and waterways.
METHODS OF CLEANING UP	If spilt, collect and reuse where possible.
REFERENCE TO OTHER SECTIONS	See Sections 4.8 & 4.13 for exposure controls and disposal.

4.7 Handling and storage

PRECAUTIONS	Before use carefully read the product label. Use of safe work practices are recommended to avoid eye or skin contact and inhalation. Observe good personal hygiene, including washing hands before eating. Prohibit eating, drinking and smoking in contaminated areas.
CONDITIONS FOR SAFE STORAGE, INCLUDING ANY INCOMPATIBILITIES	Store in a cool, dry, well ventilated area, removed from incompatible substances and foodstuffs. Ensure containers are adequately labelled, protected from physical damage and sealed when not in use.
SPECIFIC END USE(S)	No information provided.

4.8 Exposure controls / Personal protection

EXPOSURE STANDARDS

INGREDIENT	REFERENCE	TWA	STEL
CALCIUM SILICATE (A)	SWA (AUS)	10mg/m ³	–
QUARTZ (RESPIRABLE DUST)	SWA (AUS)	0.1mg/m ³	–
BIOLOGICAL LIMITS	No biological limit values have been entered for this product.		

This document has been compiled by Risk Management Technologies (RMT) on behalf of the manufacturer, importer or supplier of the product and serves as their safety data sheet (SDS). It is based on information concerning the product which has been provided to RMT by the manufacturer, importer or supplier or obtained from third party sources and is believed to represent the current state of knowledge as to the appropriate safety and handling precautions for the product at the time of issue. Further clarification regarding any aspect of the product should be obtained directly from the manufacturer, importer or supplier. While RMT has taken all due care to include accurate and up-to-date information in this SDS, it does not provide any warranty as to accuracy or completeness. As far as lawfully possible, RMT accepts no liability for any loss, injury or damage (including consequential loss) which may be suffered or incurred by any person as a consequence of their reliance on the information contained in this SDS.

Version no. 3.3. dated May 25th 2021.

4 Safety data sheet (SDS)

4.8 Exposure controls / Personal protection

EXPOSURE CONTROLS & PERSONAL PROTECTIVE EQUIPMENT

ENGINEERING CONTROLS	Avoid inhalation. Use in well ventilated areas. Where an inhalation risk exists, mechanical extraction ventilation is recommended. Maintain dust levels below the recommended exposure standard.
EYE / FACE	If cutting or sanding with potential for dust generation, wear dust-proof goggles.
HANDS	If cutting or sanding with potential for dust generation, wear leather or cotton gloves.
BODY	Not required under normal conditions of use.
RESPIRATORY	If cutting or sanding with potential for dust generation, wear a Class P1 (Particulate) respirator.

4.9 Physical and chemical properties

INFORMATION ON BASIC PHYSICAL & CHEMICAL PROPERTIES

APPEARANCE	Off white coloured board
ODOUR	Odourless
FLAMMABILITY	Non flammable
FLASH POINT	Not relevant
BOILING POINT	Not available
MELTING POINT	Not available
EVAPORATION RATE	Not available
pH	9 (approximately)
VAPOUR DENSITY	Not available
SPECIFIC GRAVITY	Not available
SOLUBILITY (WATER)	Insoluble
VAPOUR PRESSURE	Not available
UPPER EXPLOSION LIMIT	Not relevant
LOWER EXPLOSION LIMIT	Not relevant
PARTITION COEFFICIENT	Not available
AUTOIGNITION TEMPERATURE	Not available
DECOMPOSITION TEMPERATURE	Not available
VISCOSITY	Not available
EXPLOSIVE PROPERTIES	Not available
OXIDISING PROPERTIES	Not available
ODOUR THRESHOLD	Not available

This document has been compiled by Risk Management Technologies (RMT) on behalf of the manufacturer, importer or supplier of the product and serves as their safety data sheet (SDS). It is based on information concerning the product which has been provided to RMT by the manufacturer, importer or supplier or obtained from third party sources and is believed to represent the current state of knowledge as to the appropriate safety and handling precautions for the product at the time of issue. Further clarification regarding any aspect of the product should be obtained directly from the manufacturer, importer or supplier. While RMT has taken all due care to include accurate and up-to-date information in this SDS, it does not provide any warranty as to accuracy or completeness. As far as lawfully possible, RMT accepts no liability for any loss, injury or damage (including consequential loss) which may be suffered or incurred by any person as a consequence of their reliance on the information contained in this SDS.

Version no. 3.3, dated May 25th 2021.

4 Safety data sheet (SDS)

4.10 Stability and reactivity

REACTIVITY	Carefully review all information provided in Sections 4.2-4.6.
CHEMICAL STABILITY	Stable under recommended conditions of storage.
POSSIBILITY OF HAZARDOUS REACTIONS	Polymerization will not occur.
CONDITIONS TO AVOID	Avoid heat, sparks, open flames and other ignition sources.
INCOMPATIBLE MATERIALS	Compatible with most commonly used materials.
HAZARDOUS DECOMPOSITION PRODUCTS	May evolve toxic gases if heated to decomposition.

4.11 Toxicological information

ACUTE TOXICITY	Based on available data, the classification criteria are not met.
SKIN	Low irritant. Prolonged or repeated exposure to dust may result in irritation and dermatitis.
EYE	Low irritant. Due to product form, the potential for exposure is reduced, unless cut or heated and dust or fumes generated.
SENSITISATION	Not classified as causing skin or respiratory sensitisation.
MUTAGENICITY	Not classified as a mutagen.
CARCINOGENICITY	Not classified as a carcinogen. Adverse health effects, usually associated with long term exposure to high crystalline silica dust levels are not anticipated due to product form. This product may only present a hazard if the boards are cut or drilled with dust generation. Crystalline quartz is classified as carcinogenic to humans (IARC Group 1).
REPRODUCTIVE	Not classified as a reproductive toxin.
STOT – SINGLE EXPOSURE	Not classified as causing organ damage from single exposure. An inhalation hazard is not anticipated unless cut, drilled or sanded with dust generation, which may result in irritation of the nose and throat.
STOT – REPEATED EXPOSURE	Not classified as causing organ damage from repeated exposure.
ASPIRATION	This product does not present an aspiration hazard.

4.12 Ecological information

TOXICITY	No information provided.
PERSISTENCE & DEGRADABILITY	No information provided.
BIOACCUMULATIVE POTENTIAL	No information provided.
MOBILITY IN SOIL	No information provided.
OTHER ADVERSE EFFECTS	No information provided.

This document has been compiled by Risk Management Technologies (RMT) on behalf of the manufacturer, importer or supplier of the product and serves as their safety data sheet (SDS). It is based on information concerning the product which has been provided to RMT by the manufacturer, importer or supplier or obtained from third party sources and is believed to represent the current state of knowledge as to the appropriate safety and handling precautions for the product at the time of issue. Further clarification regarding any aspect of the product should be obtained directly from the manufacturer, importer or supplier. While RMT has taken all due care to include accurate and up-to-date information in this SDS, it does not provide any warranty as to accuracy or completeness. As far as lawfully possible, RMT accepts no liability for any loss, injury or damage (including consequential loss) which may be suffered or incurred by any person as a consequence of their reliance on the information contained in this SDS.

Version no. 3.3, dated May 25th 2021.

4 Safety data sheet (SDS)

4.13 Disposal considerations

WASTE DISPOSAL	Reuse where possible. No special precautions are normally required when handling this product.
LEGISLATION	Dispose of in accordance with relevant local legislation.

4.14 Transport information

NOT CLASSIFIED AS A DANGEROUS GOOD BY THE CRITERIA OF THE ADG CODE, IMDG OR IATA.

TRANSPORT TYPE	LAND (ADG)	SEA (IMDG / IMO)	AIR (IATA / ICAO)
UN NUMBER	None allocated	None allocated	None allocated
PROPER SHIPPING NAME	None allocated	None allocated	None allocated
TRANSPORT HAZARD CLASS	None allocated	None allocated	None allocated
PACKING GROUP	None allocated	None allocated	None allocated

ENVIRONMENTAL HAZARDS

ENVIRONMENTAL HAZARDS No information provided.

SPECIAL PRECAUTIONS FOR USER

HAZCHEM CODE None allocated.

4.15 Regulatory information

SAFETY, HEALTH AND ENVIRONMENTAL REGULATIONS/LEGISLATION SPECIFIC FOR THE SUBSTANCE OR MIXTURE

POISON SCHEDULE	A poison schedule number has not been allocated to this product using the criteria in the Standard for the Uniform Scheduling of Medicines and Poisons (SUSMP).
CLASSIFICATIONS	Safework Australia criteria is based on the Globally Harmonised System (GHS) of Classification and Labelling of Chemicals. The classifications and phrases listed below are based on the Approved Criteria for Classifying Hazardous Substances [NOHSC: 1008(2004)].
HAZARD CODES	None allocated.
RISK PHRASES	None allocated.
SAFETY PHRASES	None allocated.
INVENTORY LISTING(S)	AUSTRALIA: AICS (Australian Inventory of Chemical Substances) All components are listed on AICS, or are exempt.

This document has been compiled by Risk Management Technologies (RMT) on behalf of the manufacturer, importer or supplier of the product and serves as their safety data sheet (SDS). It is based on information concerning the product which has been provided to RMT by the manufacturer, importer or supplier or obtained from third party sources and is believed to represent the current state of knowledge as to the appropriate safety and handling precautions for the product at the time of issue. Further clarification regarding any aspect of the product should be obtained directly from the manufacturer, importer or supplier. While RMT has taken all due care to include accurate and up-to-date information in this SDS, it does not provide any warranty as to accuracy or completeness. As far as lawfully possible, RMT accepts no liability for any loss, injury or damage (including consequential loss) which may be suffered or incurred by any person as a consequence of their reliance on the information contained in this SDS.

Version no. 3.3, dated May 25th 2021.

4 Safety data sheet (SDS)

4.16 Other information

ADDITIONAL INFORMATION

RESPIRATORS

In general the use of respirators should be limited and engineering controls employed to avoid exposure. If respiratory equipment must be worn ensure correct respirator selection and training is undertaken. Remember that some respirators may be extremely uncomfortable when used for long periods. The use of air powered or air supplied respirators should be considered where prolonged or repeated use is necessary.

PERSONAL PROTECTIVE EQUIPMENT GUIDELINES

The recommendation for protective equipment contained within this report is provided as a guide only. Factors such as method of application, working environment, quantity used, product concentration and the availability of engineering controls should be considered before final selection of personal protective equipment is made.

HEALTH EFFECTS FROM EXPOSURE

It should be noted that the effects from exposure to this product will depend on several factors including: frequency and duration of use; quantity used; effectiveness of control measures; protective equipment used and method of application. Given that it is impractical to prepare a report which would encompass all possible scenarios, it is anticipated that users will assess the risks and apply control methods where appropriate.

ABBREVIATIONS

ACGIH	American Conference of Governmental Industrial Hygienists
CAS #	Chemical Abstract Service number used to uniquely identify chemical compounds
CNS	Central Nervous System
EC No.	European Community Number
EMS	Emergency Schedules (emergency procedures for ships carrying dangerous goods)
GHS	Globally Harmonized System
GTEPG	Group Text Emergency Procedure Guide
IARC	International Agency for Research on Cancer
LC50	Lethal Concentration, 50% / Median Lethal Concentration
LD50	Lethal Dose, 50% / Median Lethal Dose
mg/m ³	Milligrams per cubic metre
OEL	Occupational Exposure Limit
pH	Relates to hydrogen ion concentration using a scale of 0 (high acidic) to 14 (highly alkaline)
ppm	Parts per million
STEL	Short-Term Exposure Limit
STOT-RE	Specific target organ toxicity (repeated exposure)
STOT-SE	Specific target organ toxicity (single exposure)
SUSMP	Standard for the Uniform Scheduling of Medicines and Poisons
SWA	Safe Work Australia
TLV	Threshold Limit Value
TWA	Time Weighted Average

PREPARED BY

Risk Management Technologies
 5 Ventnor Ave, West Perth, WA 6005
 T +61 (8) 9322 1711 F +61 (8) 9322 1794 E info@rmt.com.au
 www.rmt.com.au.

This document has been compiled by Risk Management Technologies (RMT) on behalf of the manufacturer, importer or supplier of the product and serves as their safety data sheet (SDS). It is based on information concerning the product which has been provided to RMT by the manufacturer, importer or supplier or obtained from third party sources and is believed to represent the current state of knowledge as to the appropriate safety and handling precautions for the product at the time of issue. Further clarification regarding any aspect of the product should be obtained directly from the manufacturer, importer or supplier. While RMT has taken all due care to include accurate and up-to-date information in this SDS, it does not provide any warranty as to accuracy or completeness. As far as lawfully possible, RMT accepts no liability for any loss, injury or damage (including consequential loss) which may be suffered or incurred by any person as a consequence of their reliance on the information contained in this SDS.

Version no. 3.3, dated May 25th 2021.



Promat Australia Pty Ltd

Adelaide office

1 Scotland Road
Mile End South, SA 5031
T 1800 PROMAT (776 628)
F +61 (8) 8352 1014

New South Wales office

Unit 1, 175 Briens Road
Northmead, NSW 2152
T 1800 PROMAT (776 628)
F +61 (2) 9630 0258

Victoria office

Suite 205, 198 Harbour Esplanade
Docklands, VIC 3008
T 1800 PROMAT (776 628)
F 1800 334 598

Queensland

T 1800 011 376
F 1800 334 598

E: PAPL.Mail@etexgroup.com

- The technical data provided in this publication is based on mean values prevalent at time of publication and is thus subject to change. It should not be regarded as a guarantee to system performance.

- All data contained herein conforms to and frequently surpasses generally accepted fire protection standards recognised by most professional fire science practitioners and regulatory authorities worldwide. The same general principle is equally applicable to all Promat products and systems. Promat has access to a considerable body of test authentication data and this can be provided on a complimentary basis upon request. It should be noted however that this publication replaces all previous editions in its entirety. Any form of reproduction by any means – manual, electronic, digital or otherwise – is strictly prohibited and subject to prior approval in writing from Promat. All rights related or connected to the Promat logo, Promat registered trademarks, featured illustrations, written information and technical reports in this publication are the sole, exclusive and copyright property of Promat and its legal partner companies.

www.promat.com